
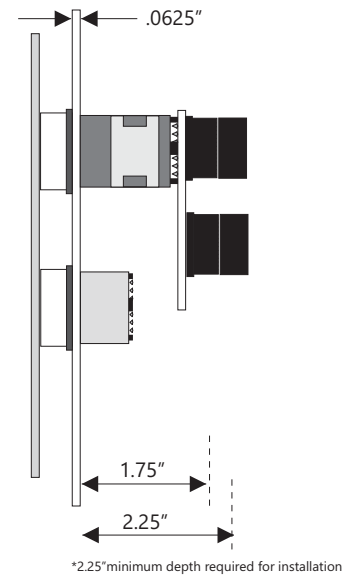


KICK PLATE WITH RESET

Kick plates are typically located inside a sterile area where it is not appropriate to touch a light panel.

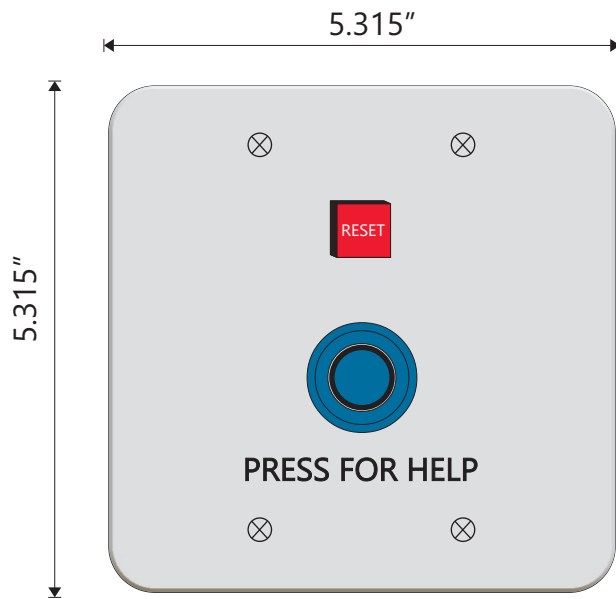

FEATURES

CUSTOMIZED

Panels may be custom designed to meet user's specific requirements.

SAFE

System operates on low voltage

SPECIFICATIONS

ELECTRICAL - KICK PLATE

- 1.0 All connections shall be fully modular to facilitate installation and maintenance.
- 1.2 Systems are UL1069 approved.
- 1.3 Connection Rj45
- 1.4 CAT 5 Cable

INSTALLATION

Pre-wire - Expeditor systems shall be wired with 24 gauge solid conductor cable. Kick plate shall require two gang box.